



Flow x1



Return x1



x 2









x 2

TB -10°C- +70°C



PB max. 6 bar

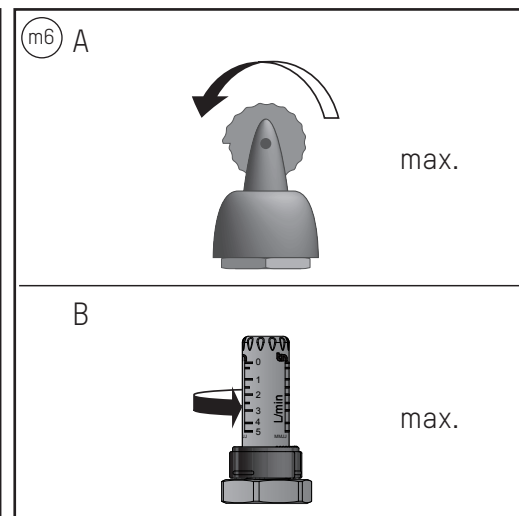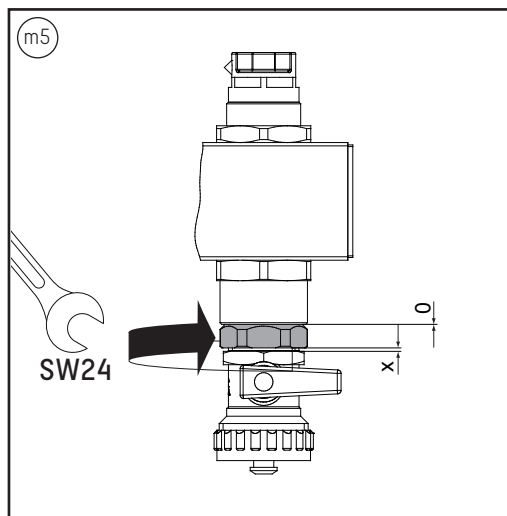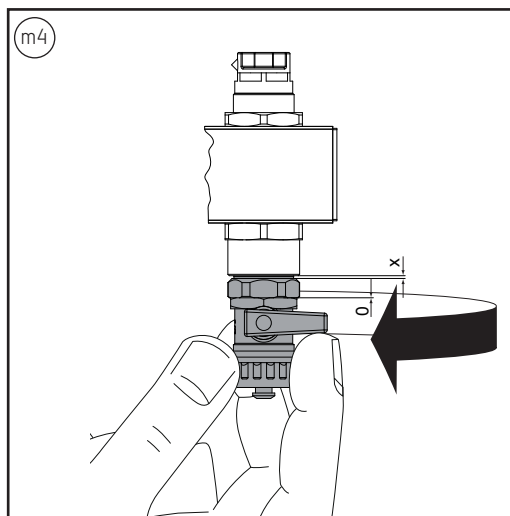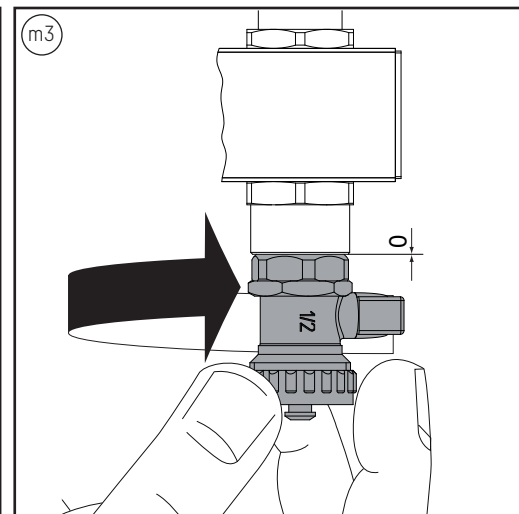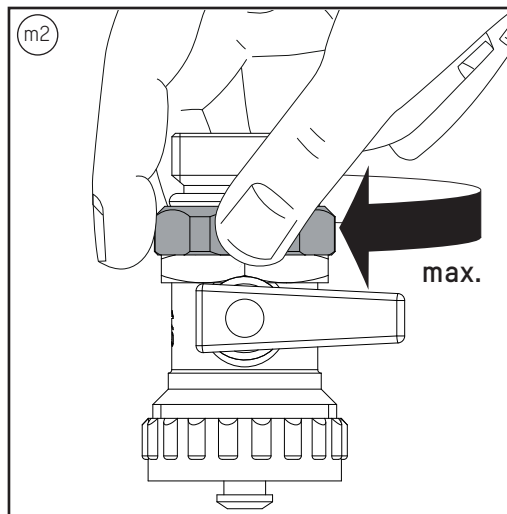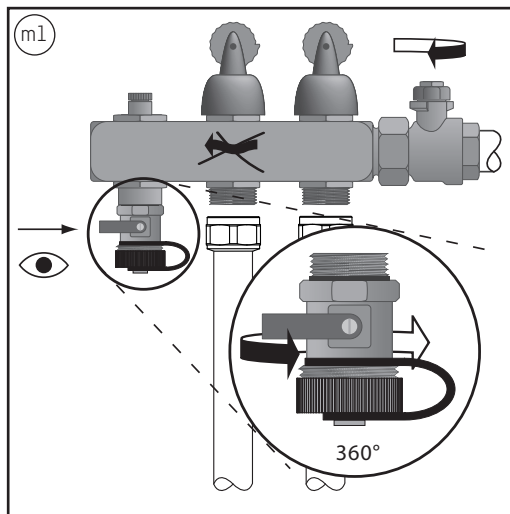



Empfehlung:

Befüllung gemäss VDI 2035
ÖNORM H 5195-1, SWKI 97-1
UNI-CTI 8065

Recommendation:

Filling according to VDI 2035
ÖNORM H 5195-1, SWKI 97-1
UNI-CTI 8065

Recommandation:

Remplir selon VDI 2035
ÖNORM H 5195-1, SWKI 97-1
UNI-CTI 8065

Raccomandazione:

Riempire in base a VDI 2035
ÖNORM H 5195-1, SWKI 97-1
UNI-CTI 8065

Recomendación:

llenar según VDI 2035
ÖNORM H 5195-1, SWKI 97-1
UNI-CTI 8065

